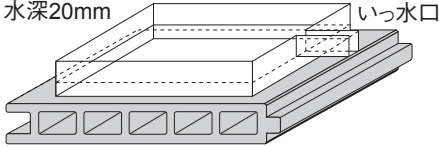
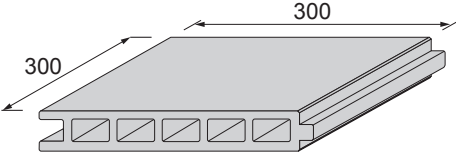
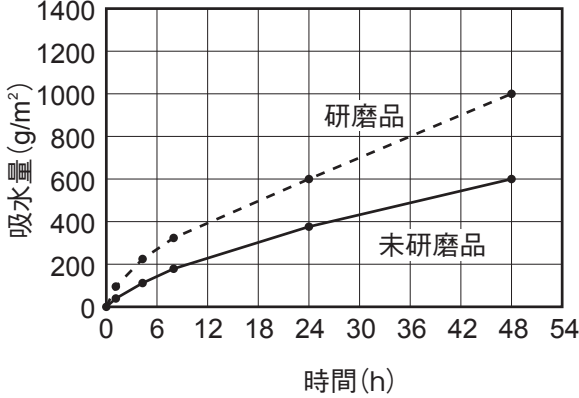


試験項目	表面吸水量																					
試験方法	<p>JIS A 1414 “建築用構成材（パネル）及びその構造部分の性能試験方法”の表面吸水試験方法に準拠</p> <div style="text-align: center;">  <p>水深20mm いっ水口</p> <p>試験方法の概要</p> </div>																					
試験体	<p>MNH-6060A 試験体の大きさ 幅 300mm 長さ 300mm 厚さ 全厚</p> <div style="text-align: center;">  </div>																					
試験結果	<table border="1" data-bbox="528 1137 1214 1442"> <thead> <tr> <th>経過時間 (時間)</th> <th>未研磨品 吸水量 (g/m²)</th> <th>研磨品 吸水量 (g/m²)</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0.0</td> <td>0.0</td> </tr> <tr> <td>1</td> <td>40.0</td> <td>100.0</td> </tr> <tr> <td>4</td> <td>115.0</td> <td>225.0</td> </tr> <tr> <td>8</td> <td>190.0</td> <td>325.0</td> </tr> <tr> <td>24</td> <td>377.5</td> <td>600.0</td> </tr> <tr> <td>48</td> <td>580.0</td> <td>1000.0</td> </tr> </tbody> </table> <div style="text-align: center;">  </div>	経過時間 (時間)	未研磨品 吸水量 (g/m ²)	研磨品 吸水量 (g/m ²)	0	0.0	0.0	1	40.0	100.0	4	115.0	225.0	8	190.0	325.0	24	377.5	600.0	48	580.0	1000.0
経過時間 (時間)	未研磨品 吸水量 (g/m ²)	研磨品 吸水量 (g/m ²)																				
0	0.0	0.0																				
1	40.0	100.0																				
4	115.0	225.0																				
8	190.0	325.0																				
24	377.5	600.0																				
48	580.0	1000.0																				
試験場所	当社建材試験所																					